

FIG. 1

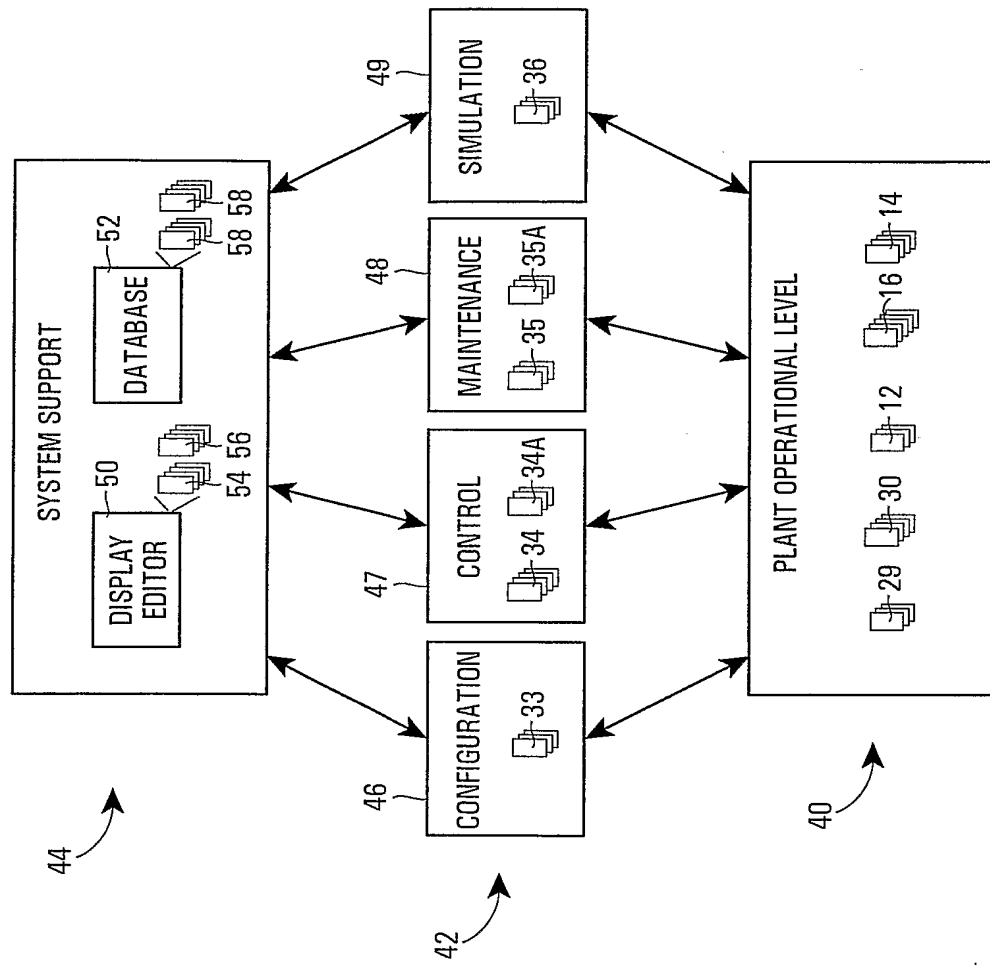
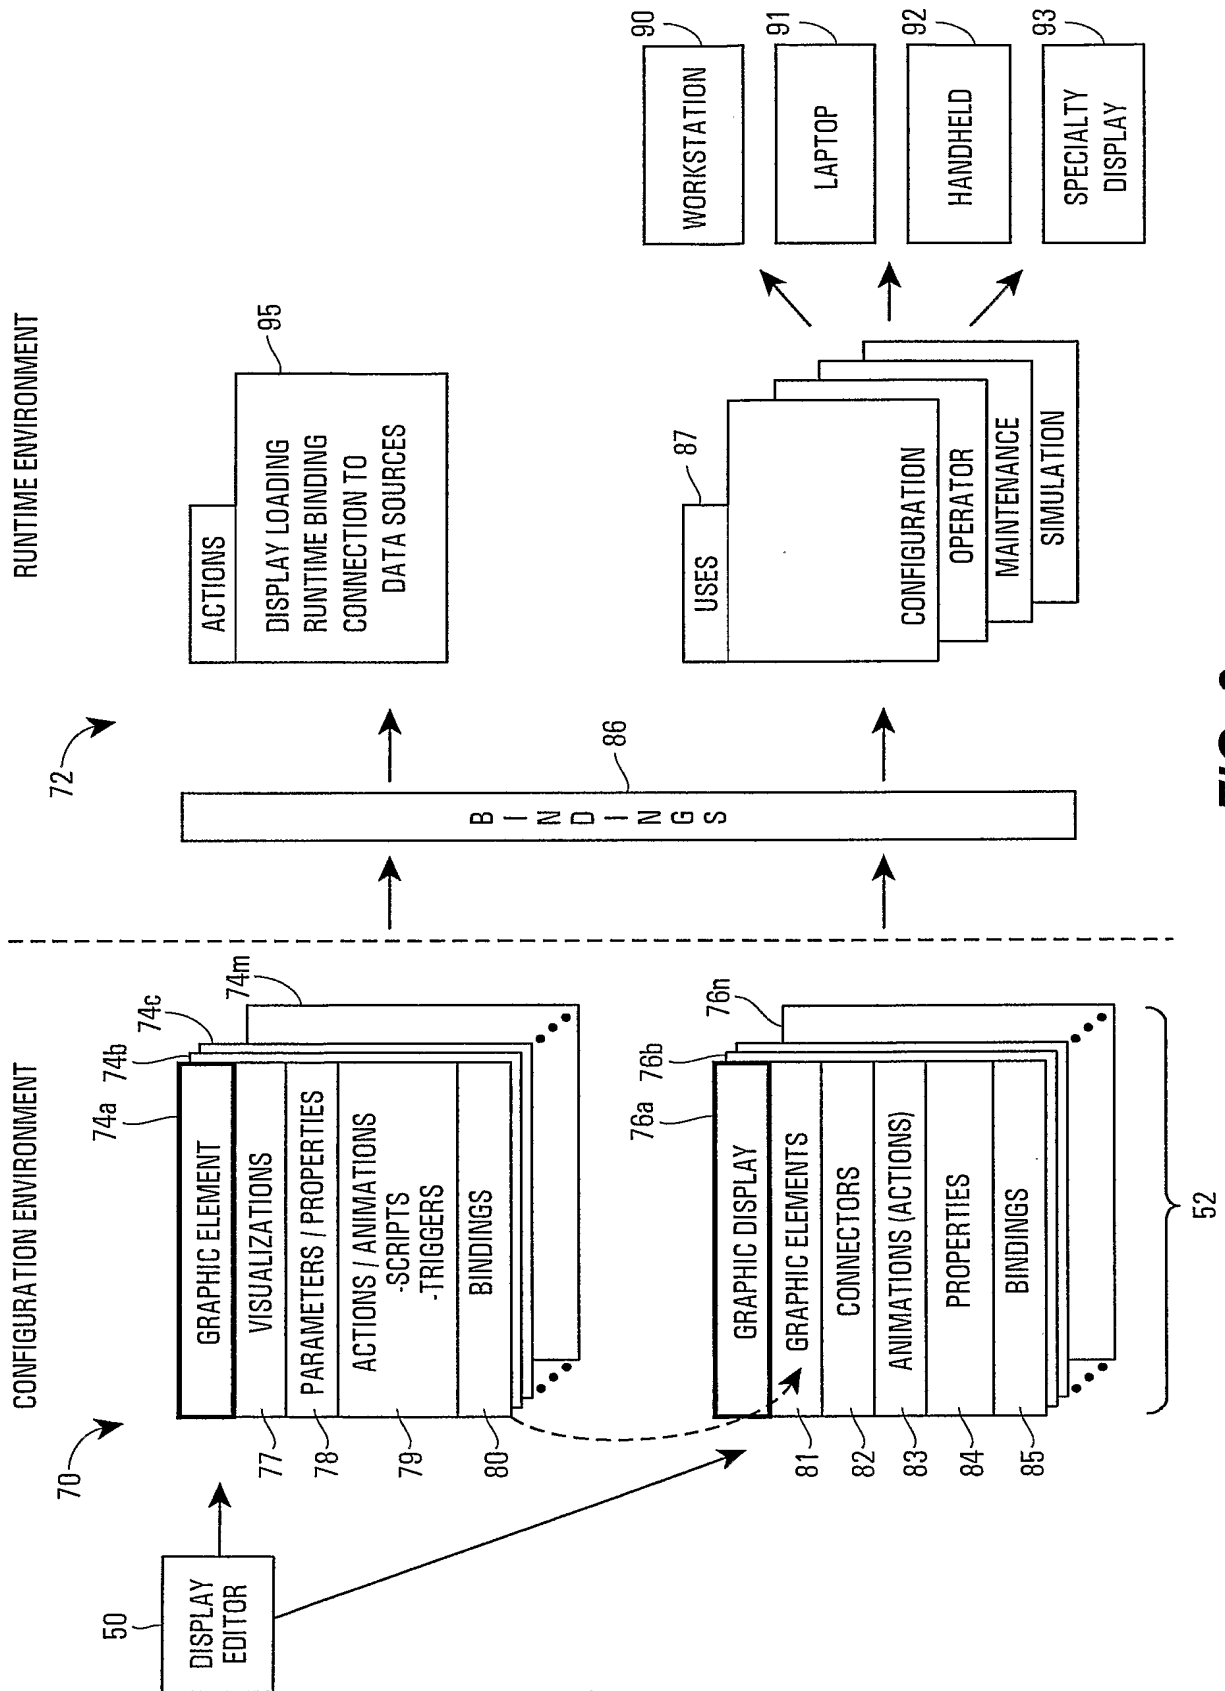


FIG. 2



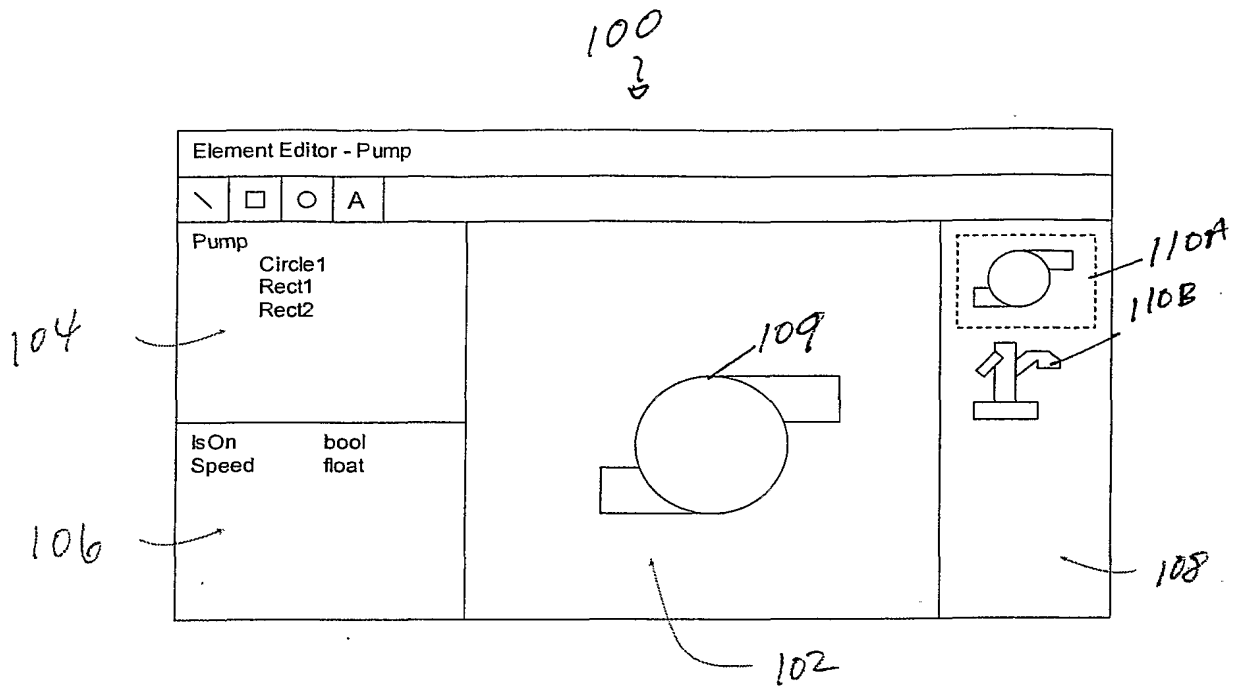


Fig. 4

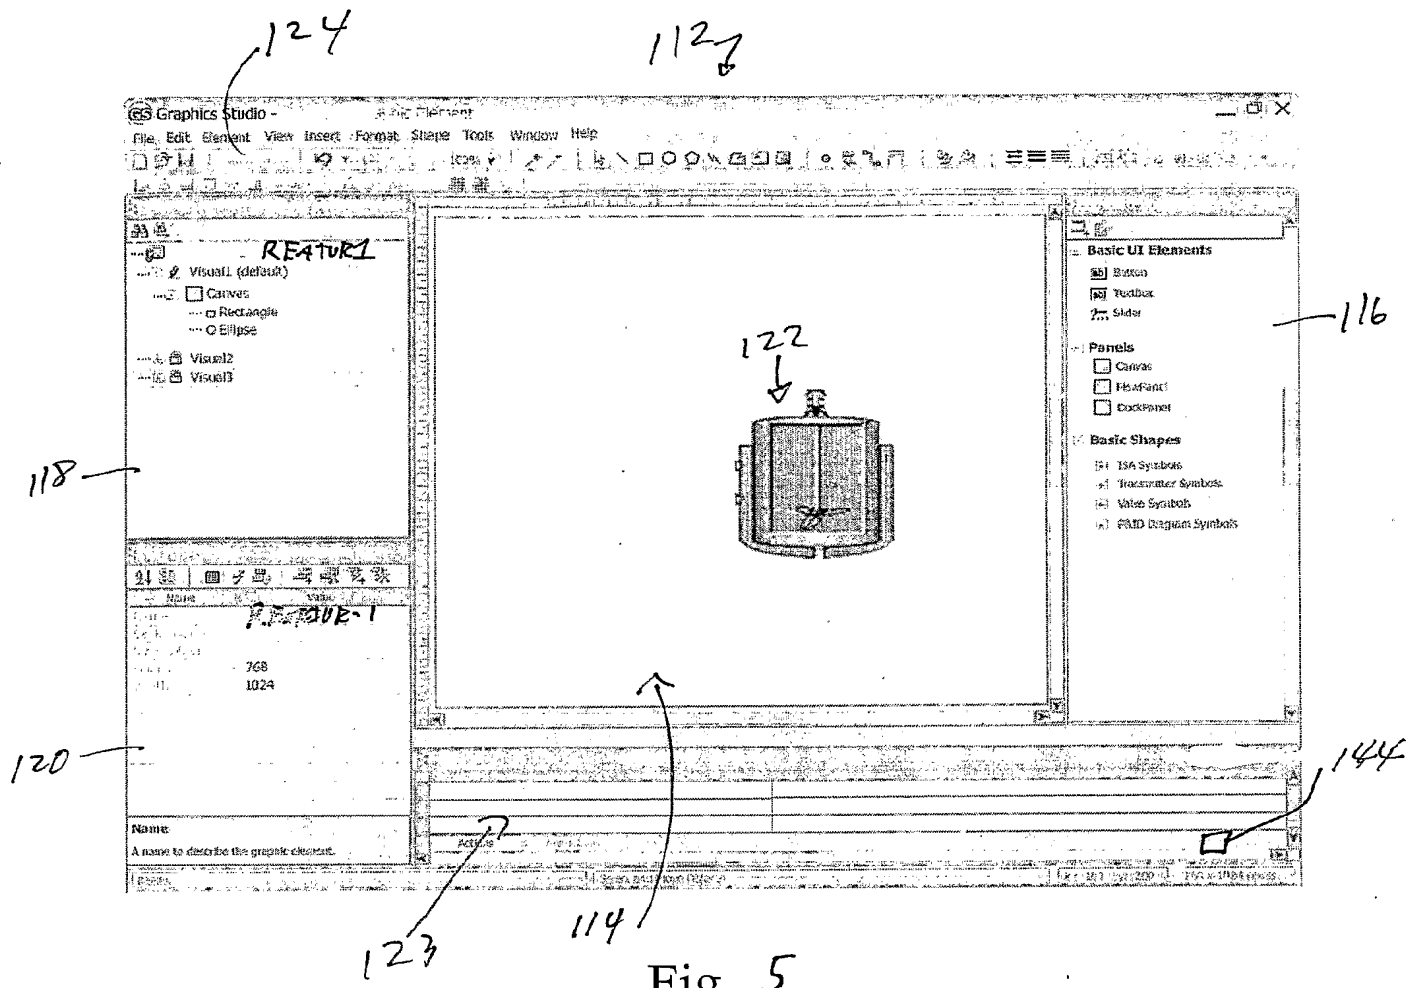
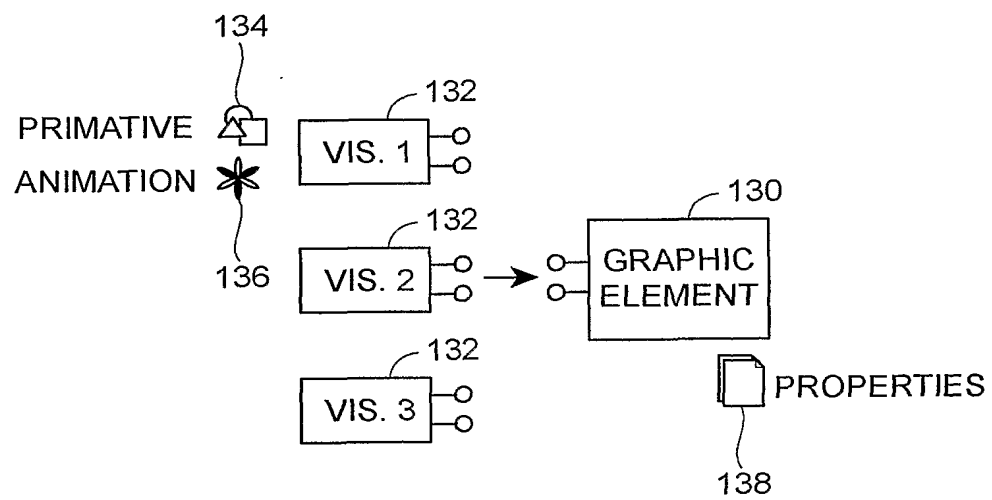


Fig. 5

**FIG. 6**

120A

Name	Data Type	Default
IsOn	Bool	True
Speed	String	Fast

IsOn
Indicates whether the pump is on or not.

FIG. 7

120B

Name	Value	Animation	Binding
Name	1		
Background	1	<input type="checkbox"/>	Spe... <input type="checkbox"/>
Description			
Height	768		
Width	1024		

IsOn
Indicates whether the pump is on or not.

FIG. 8

123A

Element Property	Value	Target	Path	Value
IsOn	True	Visual1/Rectangle1	Fill	Red
IsOn	True	Visual1/Ellipse1	Visible	False

Automatic ☐ Show All

Fig. 9

144

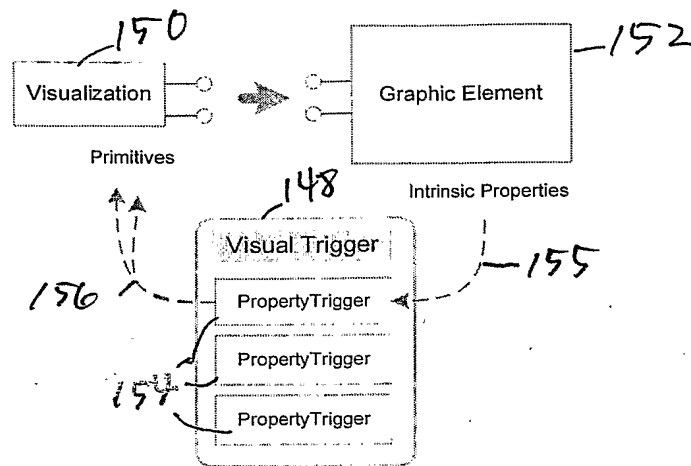


Fig. 10

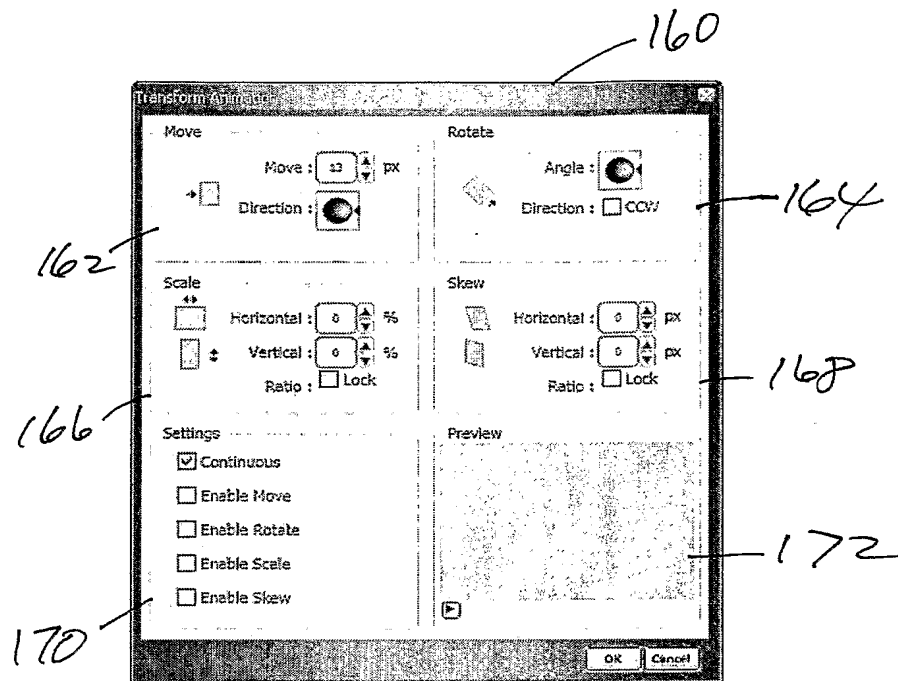


Fig. 11

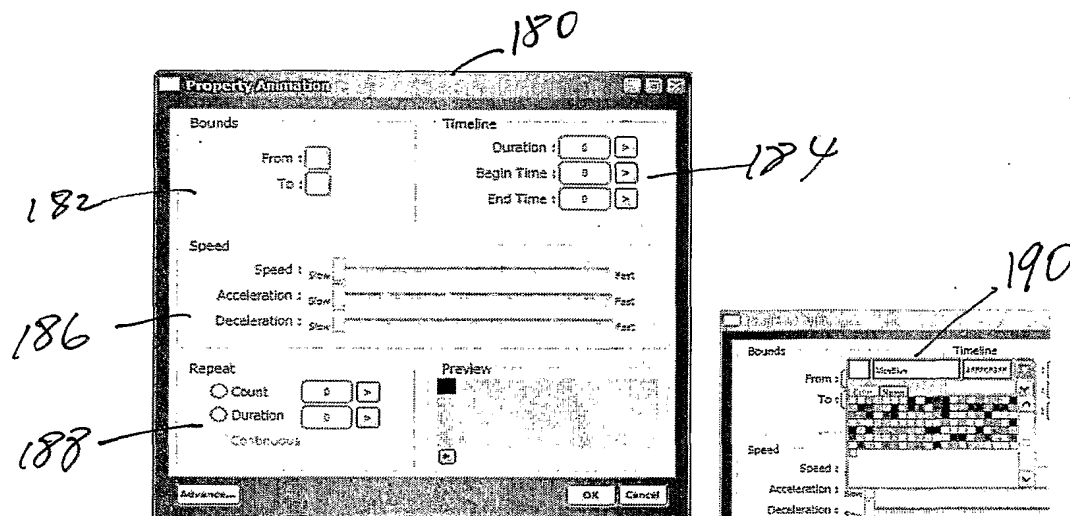
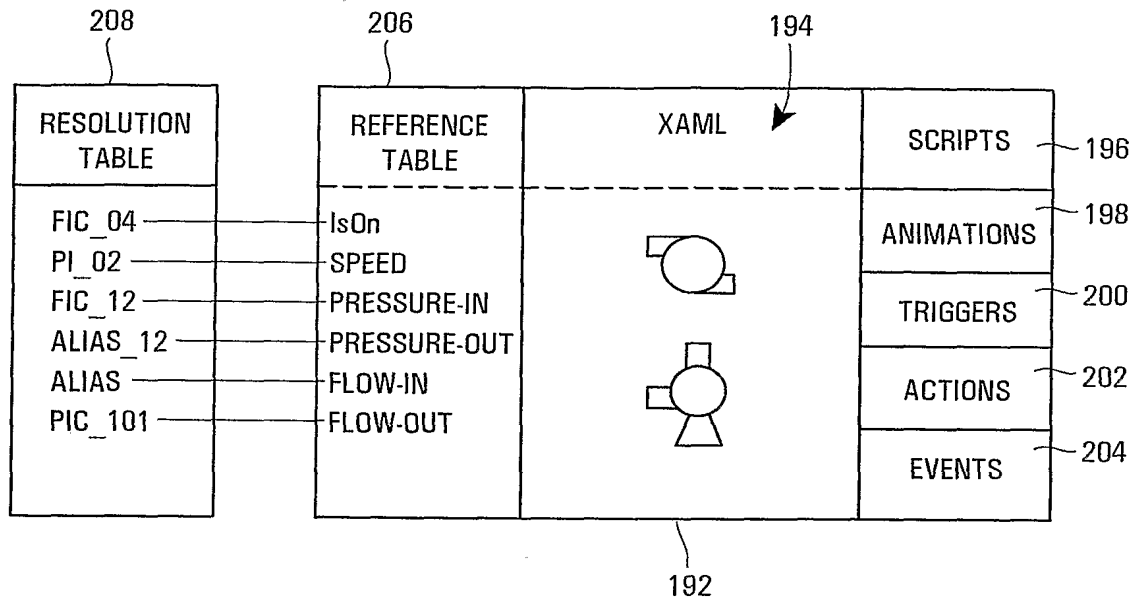
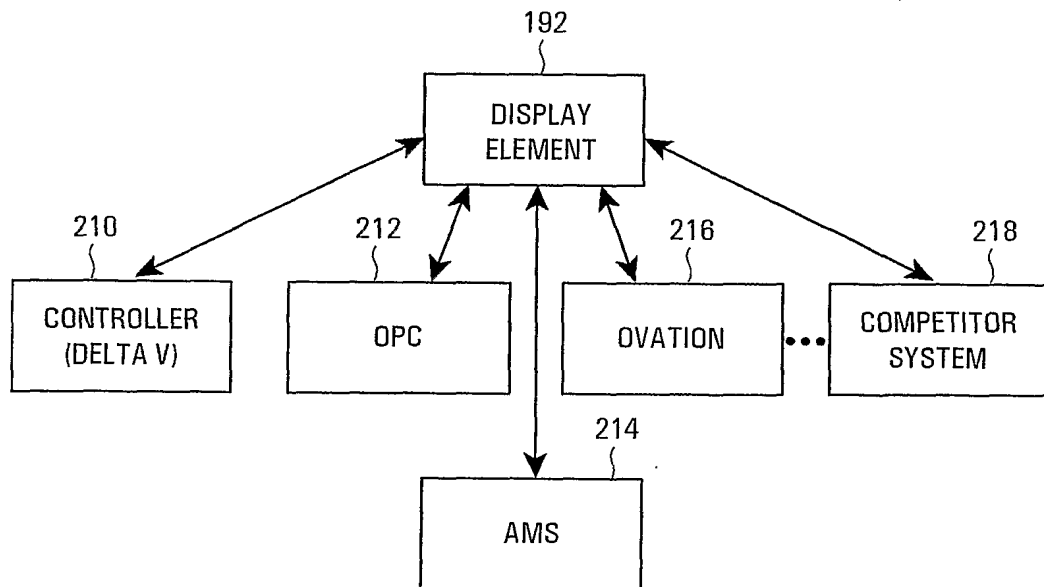
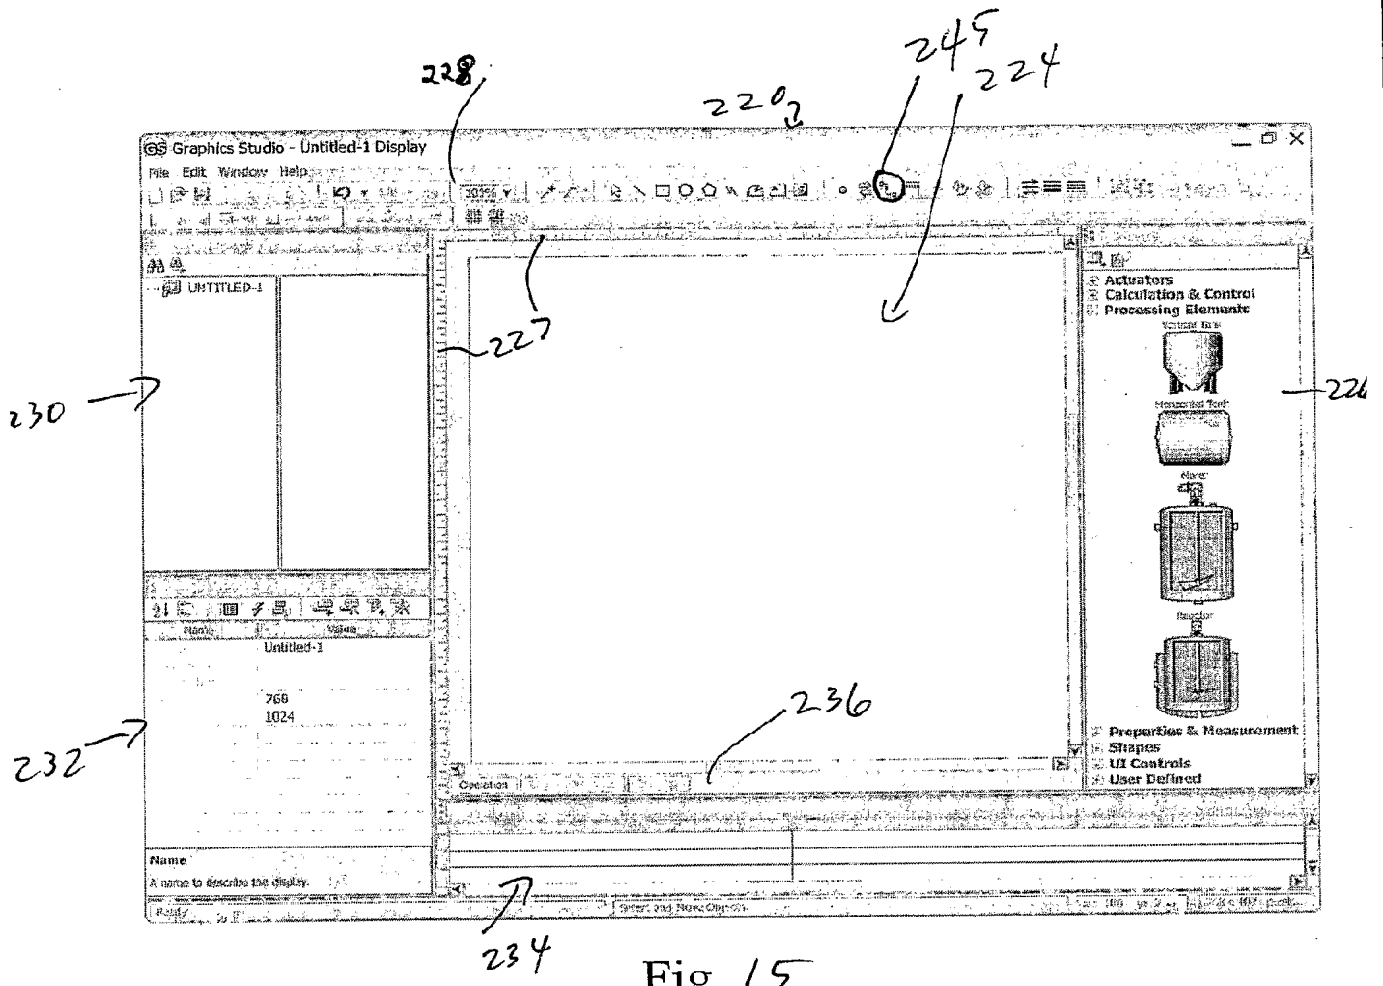


Fig. 12

**FIG. 13****FIG. 14**



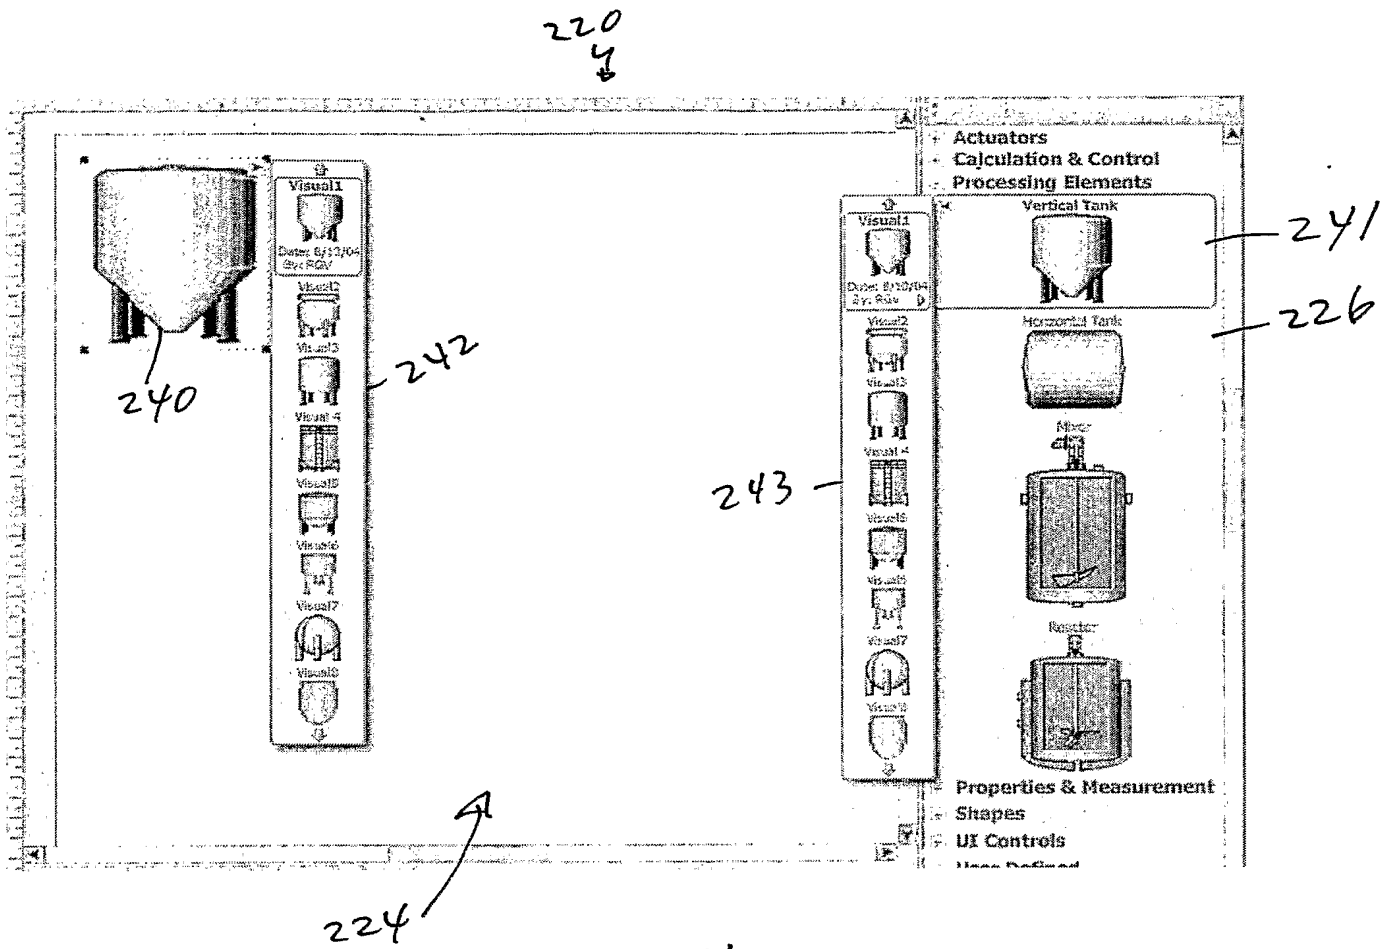


Fig. 16

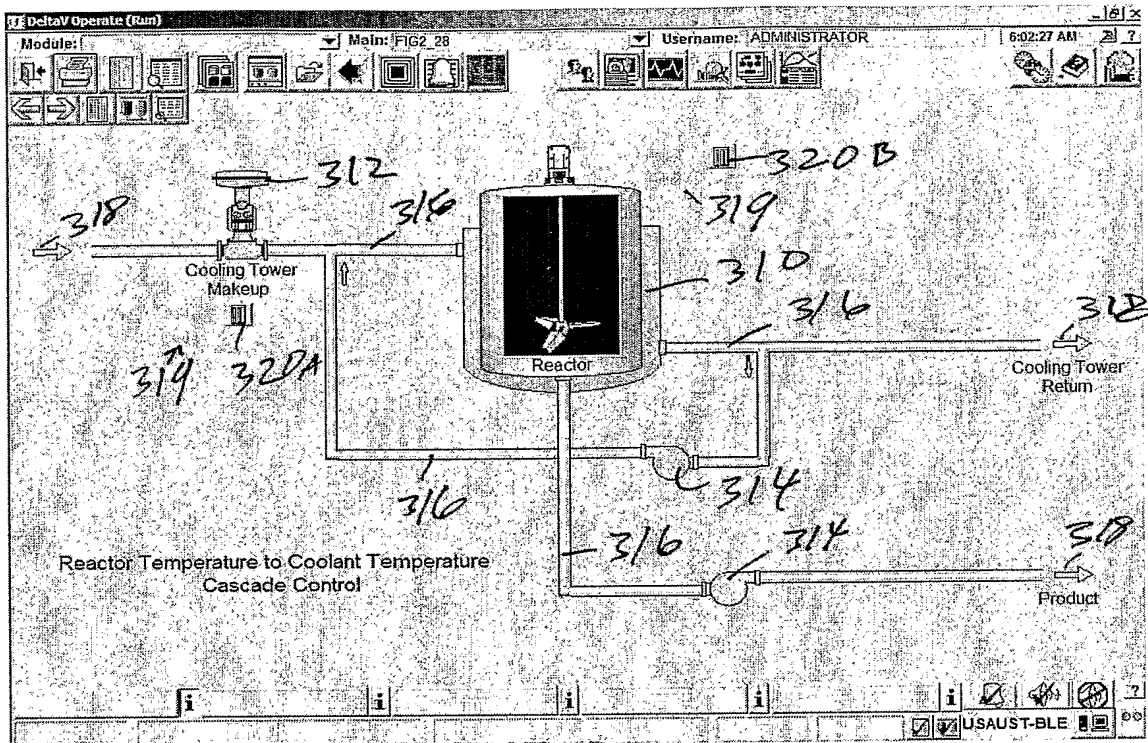


Fig. 17

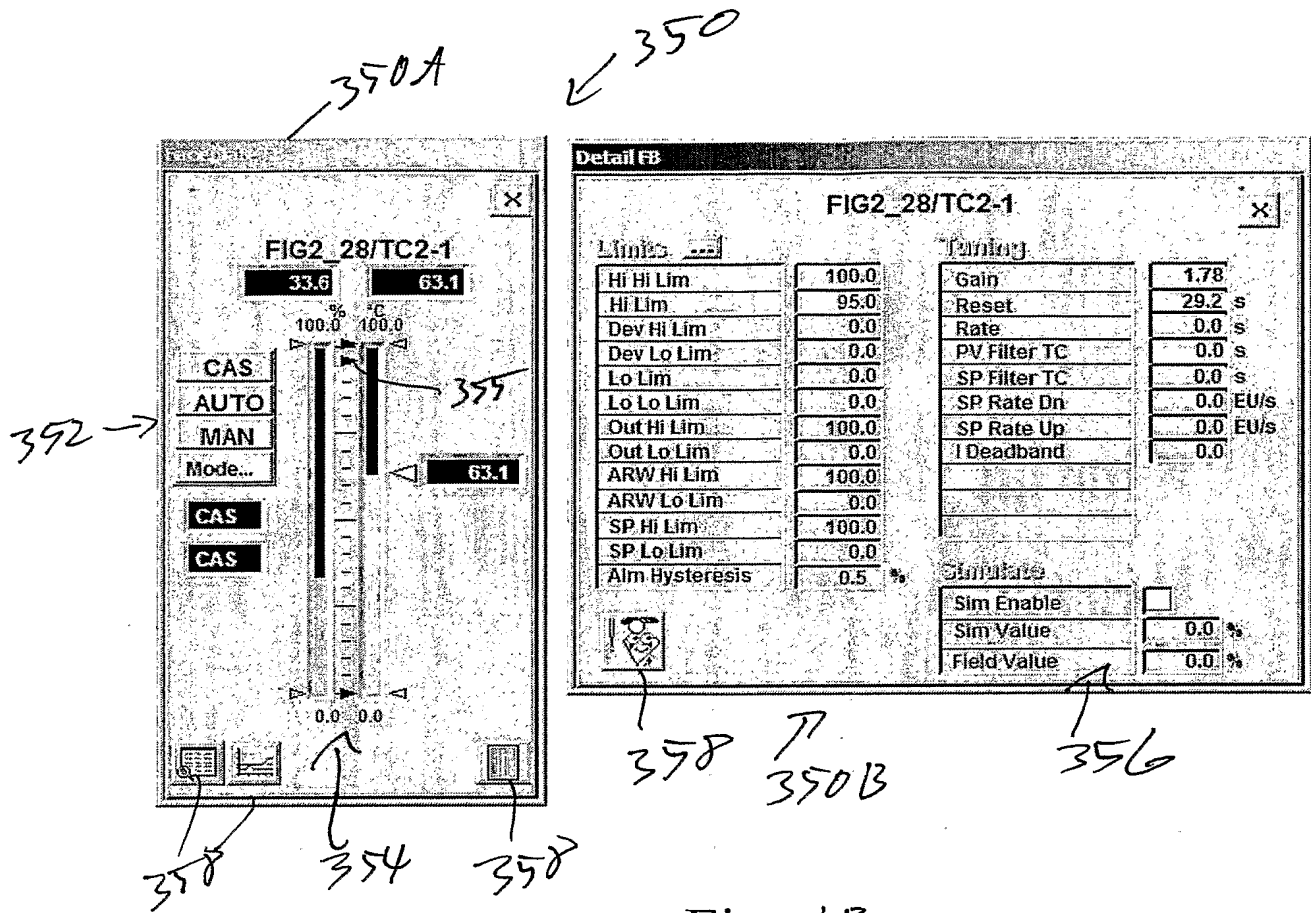


Fig. 18

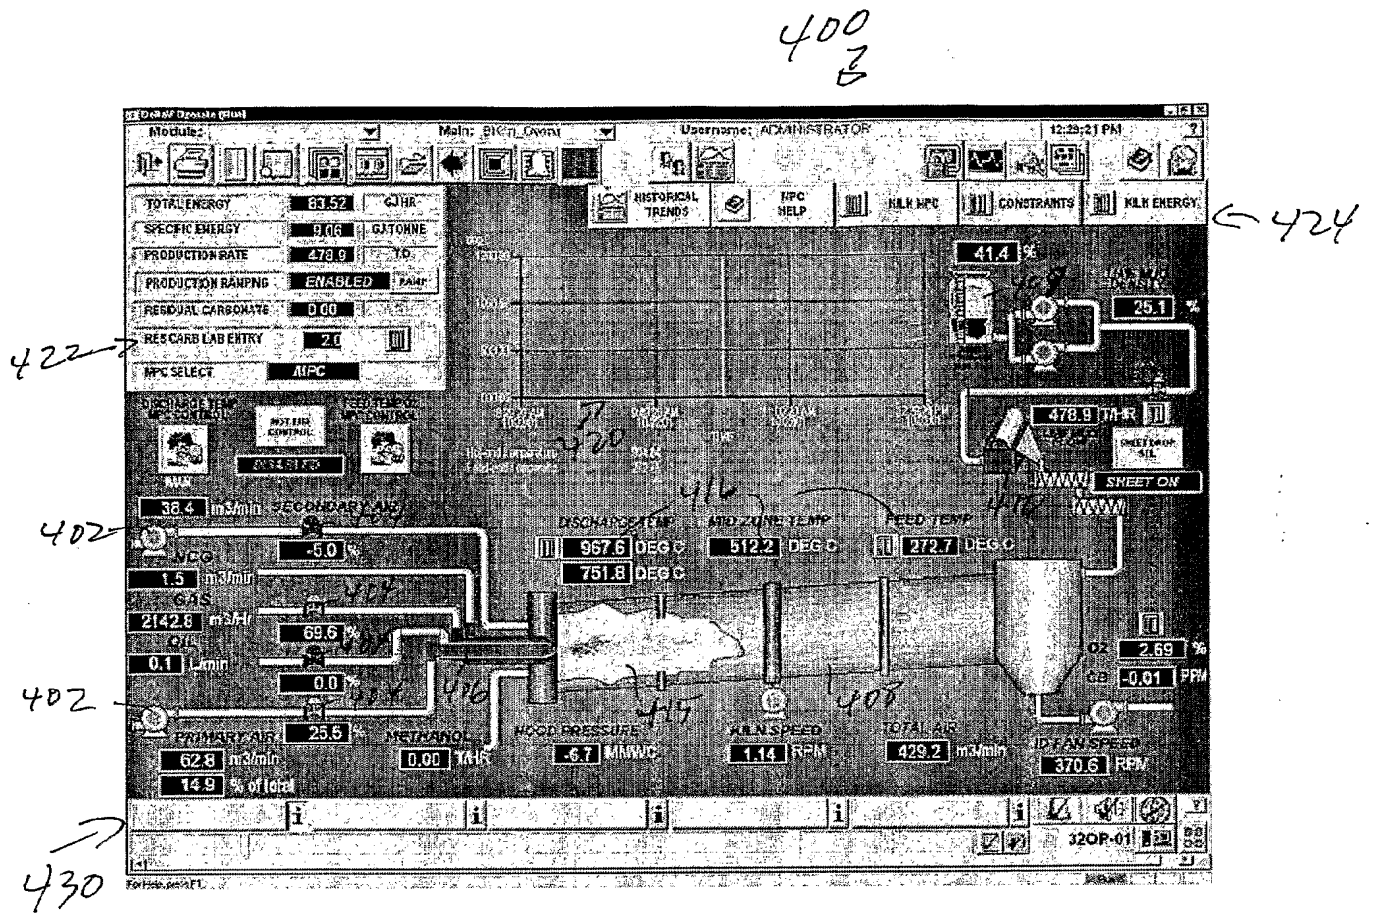


Fig. 19

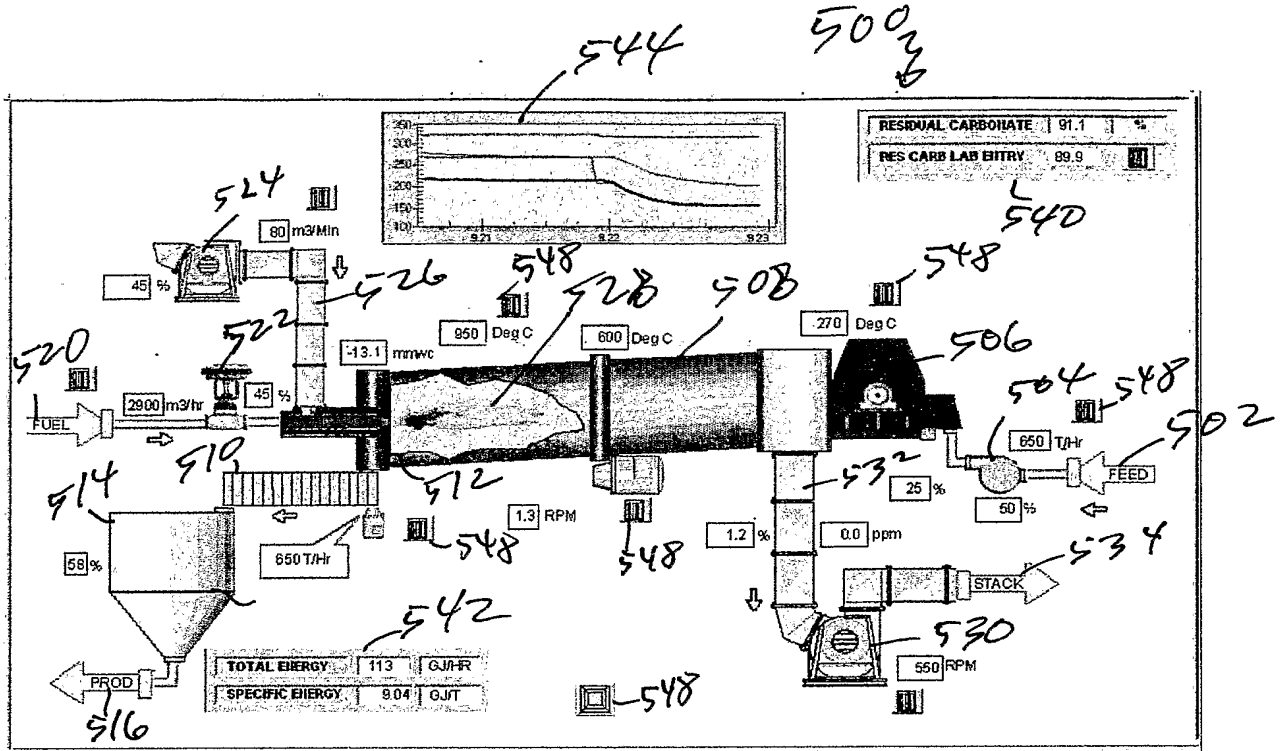


FIG. 20A

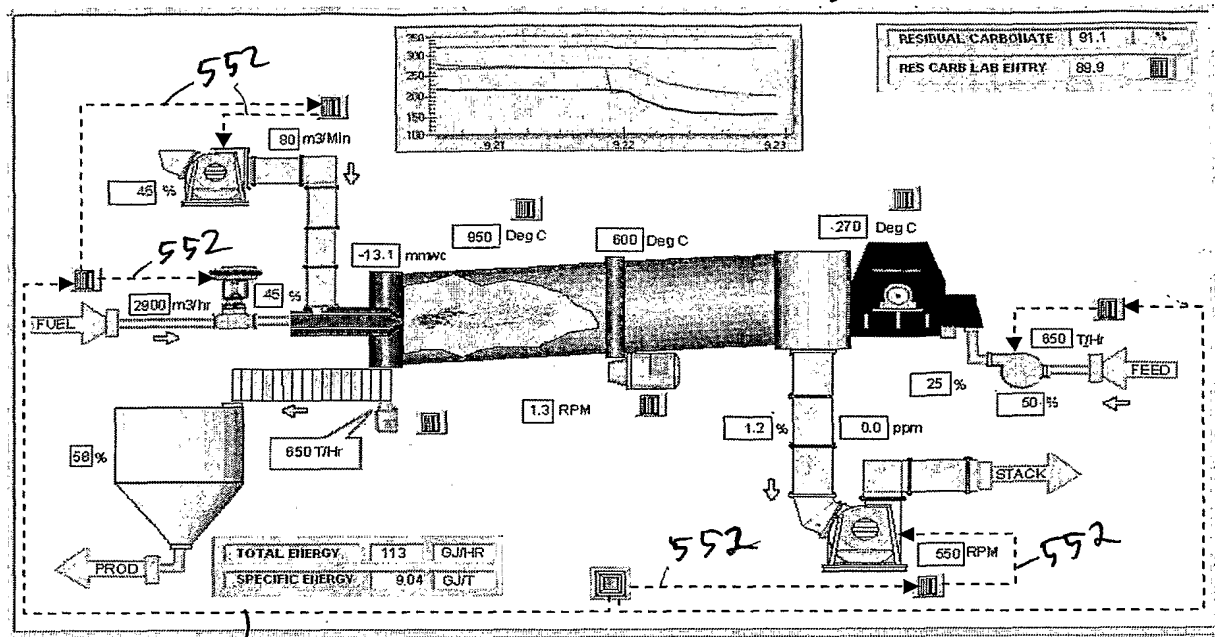


FIG. 20B

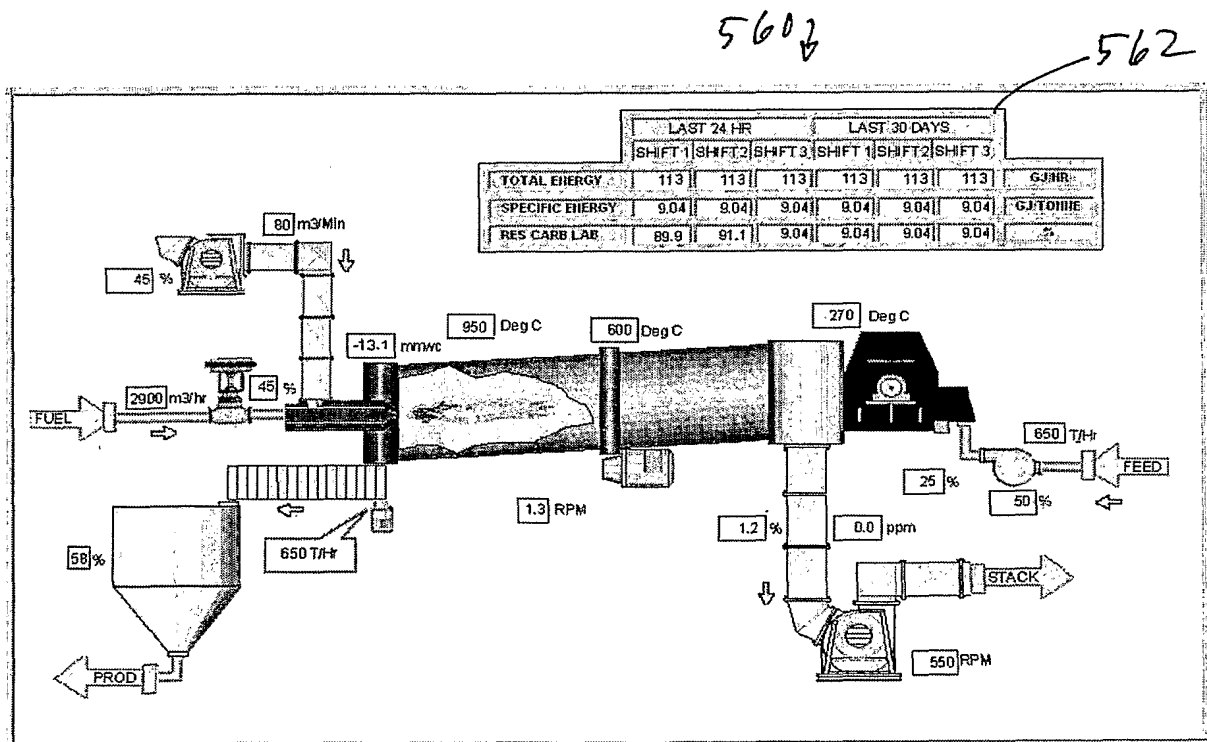


FIG. 20C

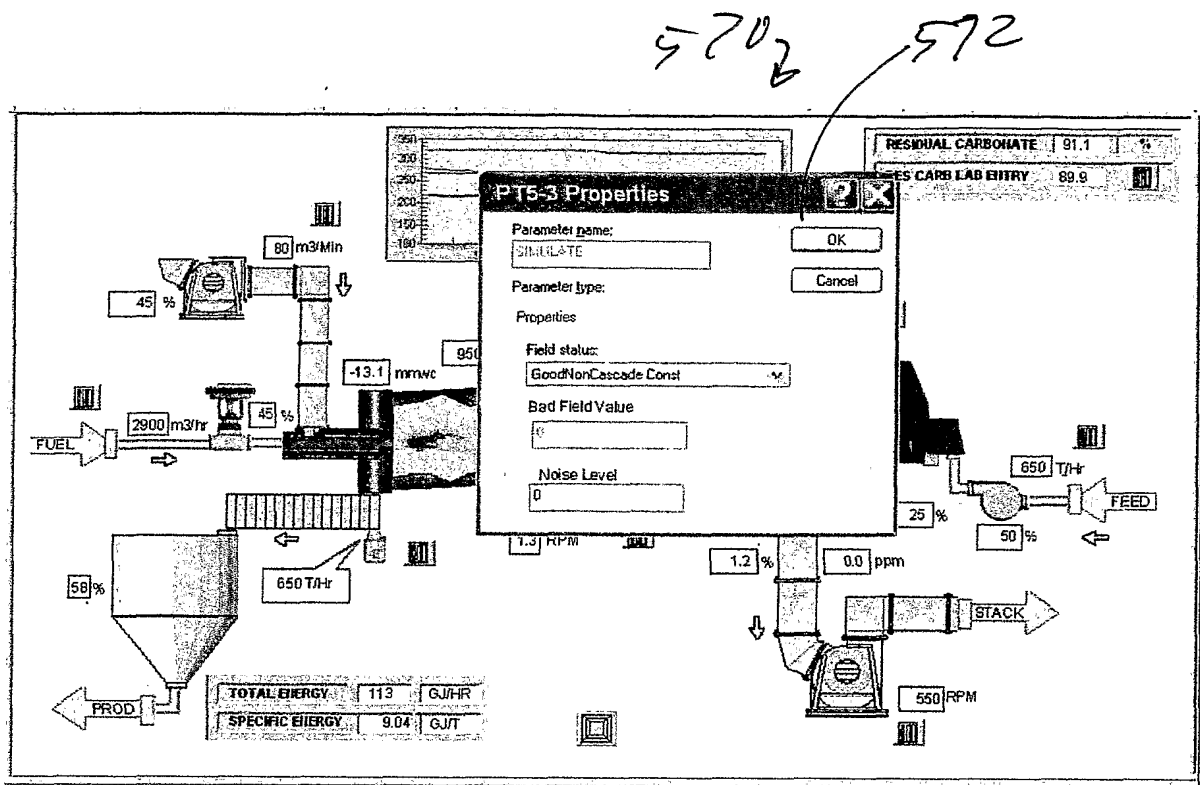


FIG. 20D

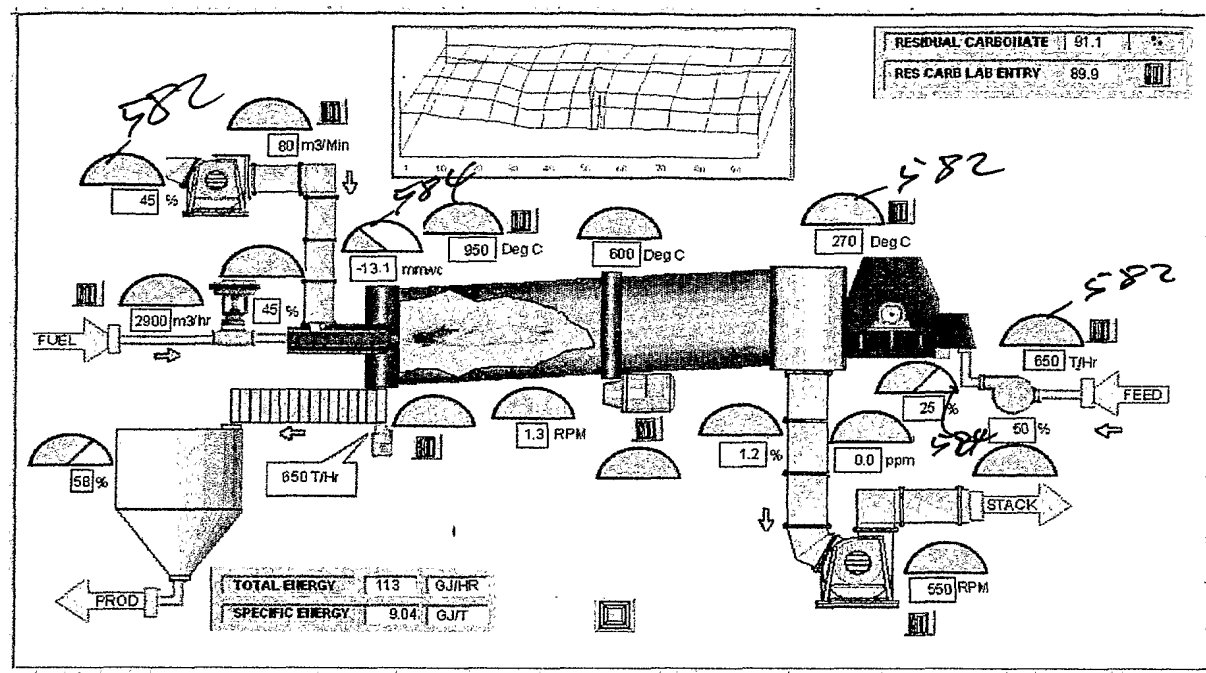


FIG. 20F

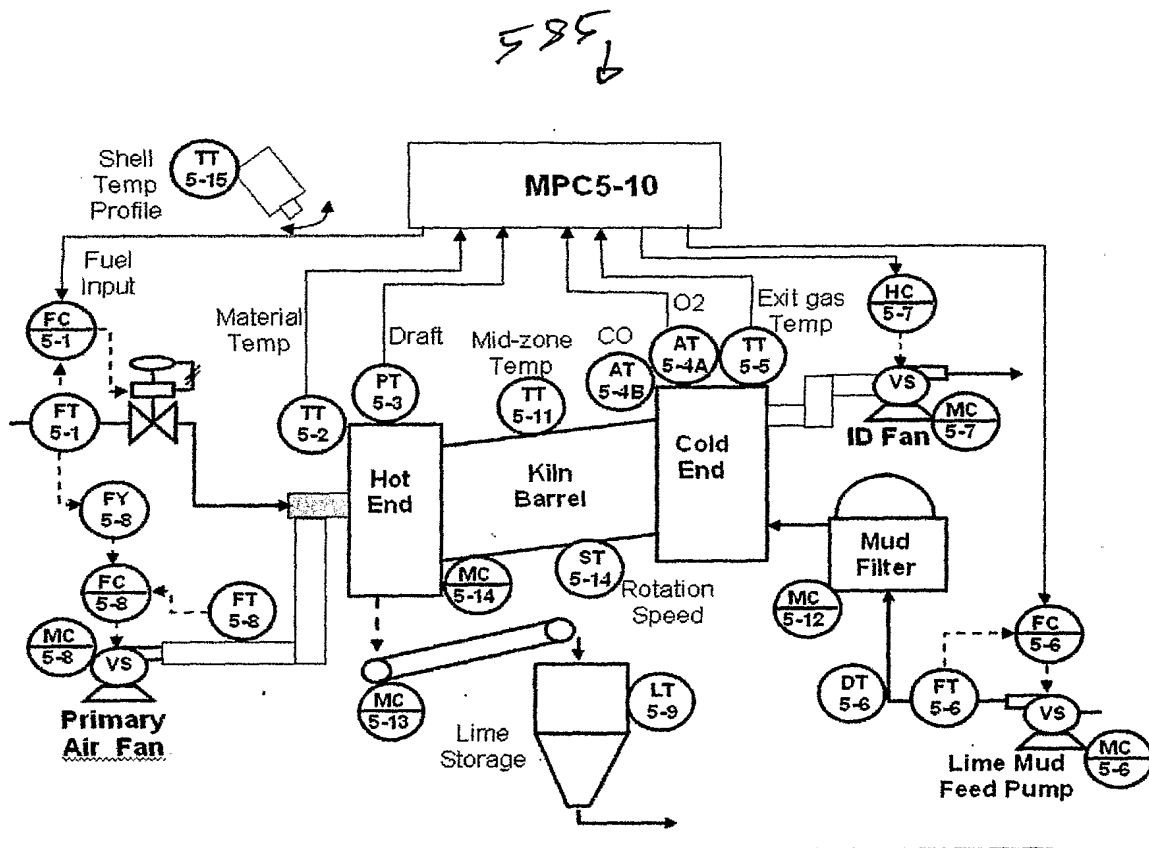


FIG. 21A

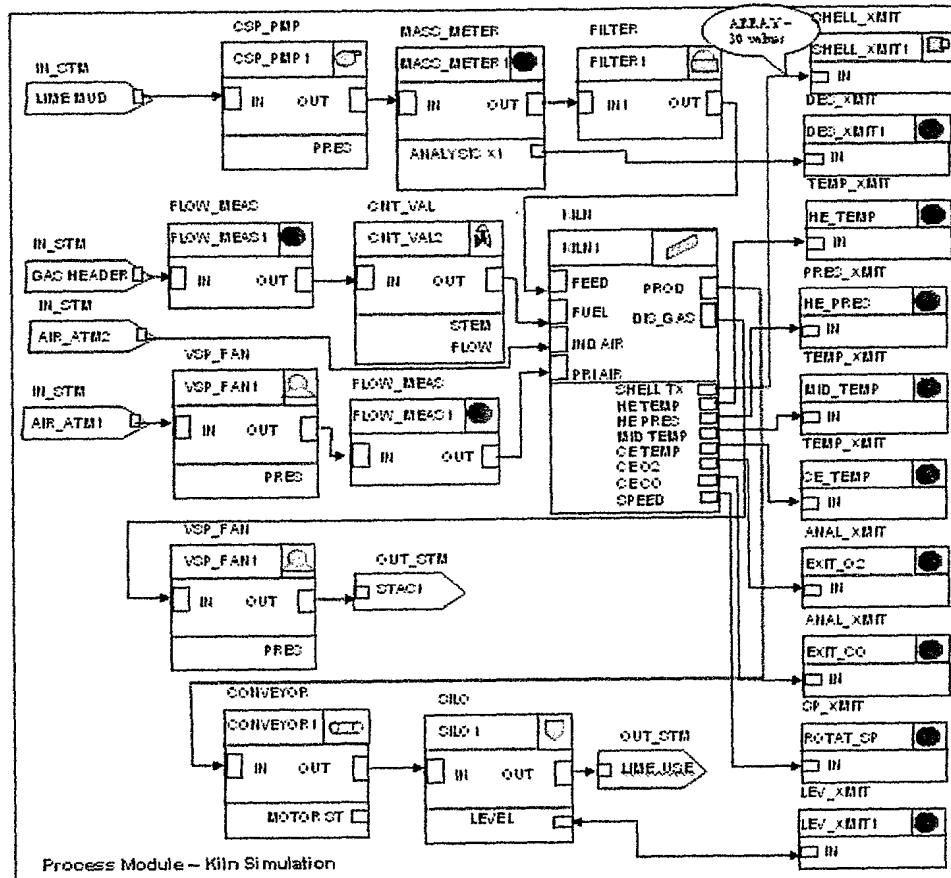
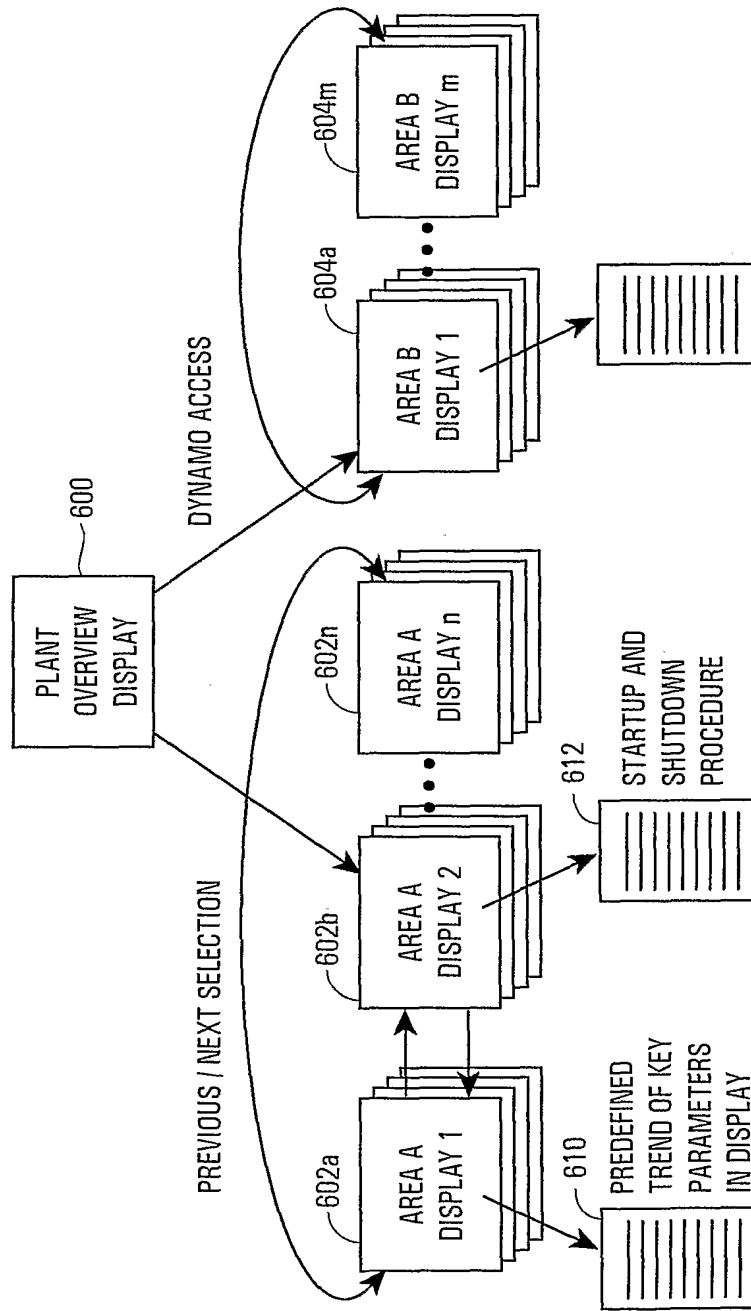


FIG. 21 B

**FIG. 22**

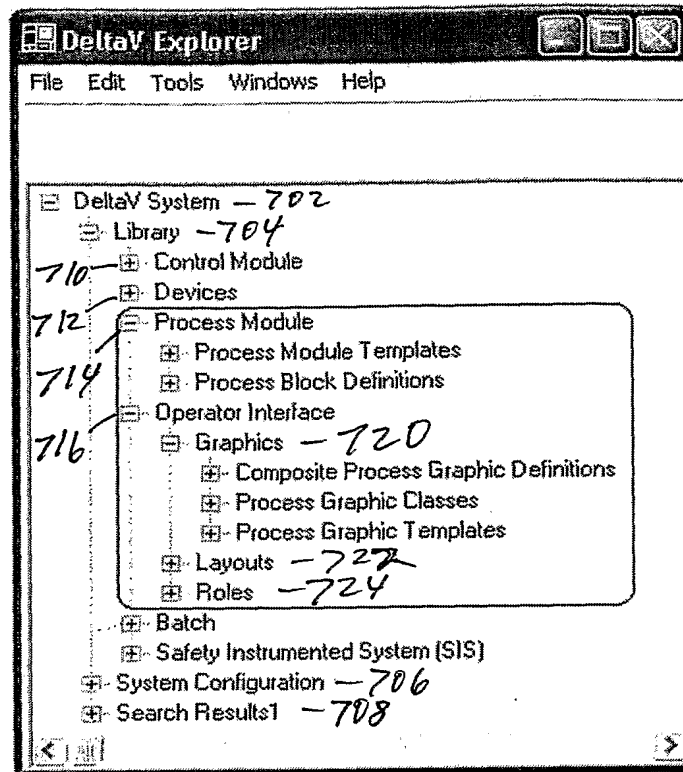


Fig. 23

References

Selected Object	Direction	Object	Type
[-] Display1	used in	Plant Area: Area_A	Primary Display
	used in	Control Module: Mod1	Primary Display
	Assigned to	Operator Station: Oper1	
[-] Display2	used in	Plant Area: Area_B	Detail Display
	used in	Control Module: Mod2	Detail Display
	Assigned to	AppStation: Wks1	

Fig. 25

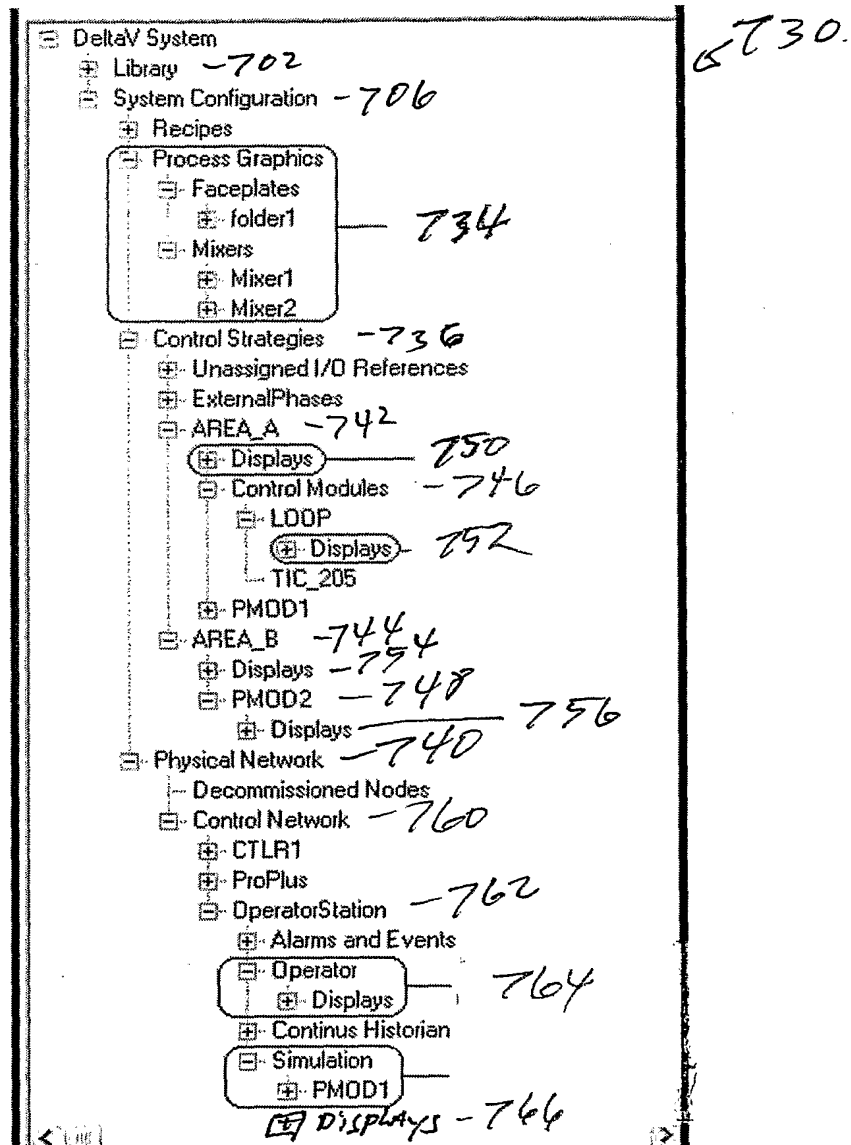


Fig. 24